


Machine Automation Controller NJ-series

EtherCAT Connection Guide

OMRON Corporation

GX-series Analog I/O Terminal

A teal-colored rectangular box with a thin white border is positioned on the right side of the page. It contains the text "Network Connection Guide" in white, sans-serif font, centered within the box.

Network
Connection
Guide

Table of Contents

1. Related Manuals	1
2. Terms and Definition	2
3. Remarks	3
4. Overview	5
5. Applicable Devices and Support Software	5
5.1. Applicable Devices.....	5
5.2. Device Configuration.....	6
6. EtherCAT Settings	7
6.1. EtherCAT Communications Settings	7
6.2. Allocating the Global Variables	7
7. Connection Procedure	8
7.1. Work Flow	8
7.2. Setting Up the Analog I/O Terminal	9
7.3. Setting Up the Controller.....	11
7.4. Connection Status Check.....	19
8. Initialization Method	23
8.1. Controller	23
9. Revision History	24

1. Related Manuals

The table below lists the manuals related to this document.

To ensure system safety, make sure to always read and heed the information provided in all Safety Precautions, Precautions for Safe Use, and Precaution for Correct Use of manuals for each device which is used in the system.

Cat.No.	Model	Manual name
W500	NJ501-□□□□□	NJ-series CPU Unit Hardware User's Manual
W501	NJ501-□□□□□	NJ-series CPU Unit Software User's Manual
W505	NJ501-□□□□□	NJ-series CPU Unit Built-in EtherCAT Port User's Manual
W504	SYSMAC-SE2□□□□	Sysmac Studio Version 1 Operation Manual
W488	GX-series	EtherCAT Slave Units User's Manual

2. Terms and Definition

Terms	Explanation and Definition
PDO Communications (Communications using Process Data Objects)	<p>This method is used for cyclic data exchange between the master unit and the slave units.</p> <p>PDO data (i.e., I/O data that is mapped to PDOs) that is allocated in advance is refreshed periodically each EtherCAT process data communications cycle (i.e., the period of primary periodic task).</p> <p>The EtherCAT port built into the NJ-series CPU Unit uses process data communications for commands to refresh I/O data in a fixed control period, including I/O data for EtherCAT Slave Units, and the position control data for the Servomotors.</p> <p>Variables are used to access from the NJ-series CPU Unit in the following ways.</p> <ul style="list-style-type: none"> •With device variables for EtherCAT slave I/O •With Axis Variables for Servo Drive and encoder input slaves to which assigned as an axis
SDO Communications (Communications using Service Data Objects)	<p>This method is used to read and write the specified slave unit data from the master unit when required.</p> <p>The EtherCAT port built into the NJ-series CPU Unit uses SDO communications for commands to read and write data, such as for parameter transfers, at specified times.</p> <p>You can read/write the following specified slave data with the EC_CoESDORead (Read CoE SDO) instruction or the EC_CoESDOWrite (Write CoE SDO) instruction.</p> <ul style="list-style-type: none"> •SDO data in slave units (parameters, error information, etc.)
Slave Unit	<p>There are various types of slaves such as Servo Drives that handle position data and I/O terminals that control the bit signals.</p> <p>The slave receives output data sent from the master, and transmits input data to the master.</p>
Node address	<p>An address to identify the unit connected to the EtherCAT network.</p>
ESI file (EtherCAT Slave Information file)	<p>The ESI files contain information unique to the EtherCAT slaves in XML format.</p> <p>Install an ESI file into the Sysmac Studio, to easily allocate slave process data and make other settings.</p>

3. Remarks

- (1) Understand the specifications of devices which are used in the system. Allow some margin for ratings and performance. Provide safety measures, such as installing safety circuit in order to ensure safety and minimize risks of abnormal occurrence.
- (2) To ensure system safety, always read and heed the information provided in all Safety Precautions, Precautions for Safe Use, and Precaution for Correct Use of manuals for each device which is used in the system.
- (3) The users are encouraged to confirm the standards and regulations that the system must conform to.
- (4) It is prohibited to copy, to reproduce, and to distribute a part of or whole part of this document without the permission of OMRON Corporation.
- (5) This document provides the latest information as of February 2013. The information contained in this document is subject to change for improvement without notice.

About Intellectual Property Right and Trademarks

Microsoft product screen shots reprinted with permission from Microsoft Corporation.

Windows is a registered trademark of Microsoft Corporation in the USA and other countries.

EtherCAT® is registered trademark and patented technology, licensed by Beckhoff Automation GmbH, Germany.

Company names and product names in this document are the trademarks or registered trademarks of their respective companies.

The following notation is used in this document.



WARNING

Indicates a potentially hazardous situation which, if not avoided, could result in death or serious injury. Additionally, there may be severe property damage.



Caution

Indicates a potentially hazardous situation which, if not avoided, may result in minor or moderate injury, or property damage.



The filled circle symbol indicates operations that you must do. The specific operation is shown in the circle and explained in text. This example shows a general precaution for something that you must do.



Precautions for Safe Use

Indicates precautions on what to do and what not to do to ensure using the product safely.



Precautions for Correct Use

Indicates precautions on what to do and what not to do to ensure proper operation and performance.



Additional Information

Provides useful information.

Additional information to increase understanding or make operation easier.

4. Overview

This document describes the procedure for connecting the Analog I/O Terminal (GX Series) of OMRON Corporation (hereinafter referred to as OMRON) to the NJ-series Machine Automation Controller (hereinafter referred to as Controller) on EtherCAT and provides the procedure for checking their connection.

Refer to *Section 7 Connection Procedure* to understand the setting method and key points to connect the devices via EtherCAT.

5. Applicable Devices and Support Software

5.1. Applicable Devices

The following devices can be connected.

Manufacturer	Name	Model	Version
OMRON	NJ5-series CPU Unit	NJ501-□□□□□□	-
OMRON	Analog I/O Terminal	GX-AD0471 GX-DA0271	1.1



Additional Information

As applicable devices above, the devices listed in Section 5.2. are actually used in this document to check the connection. When using devices not listed in Section 5.2, check the connection by referring to the procedure in this document.




Additional Information

This document describes the procedure to establish the network connection. It does not provide information about operation, installation nor wiring method of each device.

For details on the above products (other than communication connection procedures), refer to the manuals for the corresponding products or contact your OMRON representative.

5.2. Device Configuration

The hardware components to reproduce the connection procedure of this document are as follows.

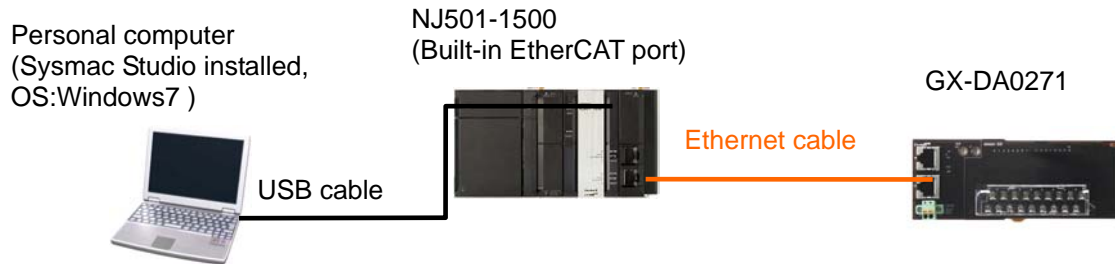

Manufacturer	Name	Model	Version
OMRON	CPU Unit (Built-in EtherCAT port)	NJ501-1500	
OMRON	Power Supply Unit	NJ1W-PA3001	
OMRON	Sysmac Studio	SYSMAC-SE2□□□□	Ver.1.00
-	Personal computer (OS:Windows7)		
-	USB cable (USB 2.0 type B connector)		
OMRON	Ethernet cable (with industrial Ethernet connector)	XS5W-T421-□M□-K	
OMRON	Analog I/O Terminal	GX-DA0271	V1.1

Precautions for Correct Use

The connection line of EtherCAT communication cannot be shared with other network, such as Ethernet or EtherNet/IP.

The switching hub for Ethernet cannot be used for EtherCAT.

Please use the cable of category 5 or higher, double-shielded with aluminum tape and braided shielding and the shielded connector of category 5 or higher.

Additional Information

For information on the specifications of the Ethernet cable and network wiring, refer to *Section 4 EtherCAT Network Wiring* in the *NJ-series CPU Unit Built-in EtherCAT Port User's Manual* (Cat. No. W505).

Additional Information

The system configuration in this document uses USB for the connection between the personal computer and the NJ-series CPU Unit. For information on how to install a USB driver, refer to *A-1 Driver Installation for Direct USB Cable Connection* of the *Sysmac Studio Operation Manual* (Cat.No. W504).

6. EtherCAT Settings

This section provides specifications such as communications parameters and variable names that are set in this document.

6.1. EtherCAT Communications Settings

The following is the setting of the destination device.

	GX-DA0271
Node address	01

6.2. Allocating the Global Variables

The device variables of the destination device are allocated to the Controller's global variables.

The relationship between the device data and the global variables is shown below.

•Output area (Controller → Destination device)

Destination device data	Global variable name	Data type
CH1 Analog output value	E001_CH1_Output_16bit	INT
CH2 Analog output value	E001_CH2_Output_16bit	INT

•Details of the status allocation (Controller ← Destination device)

Destination device data	Global variable name	Data type
Sysmac Error Status	E001_Sysmac_Error_Status	BYTE
Error information at observation level	E001_Observation	BOOL
Error information at minor fault level	E001_Minor_Fault	BOOL


7. Connection Procedure

This section describes how to connect the Controller via EtherCAT.

This document explains the procedures for setting up the Controller and Analog I/O Terminal from the factory default setting. For the initialization, refer to *Section 8 Initialization Method*.

7.1. Work Flow

The following is the procedure for connecting to the EtherCAT.

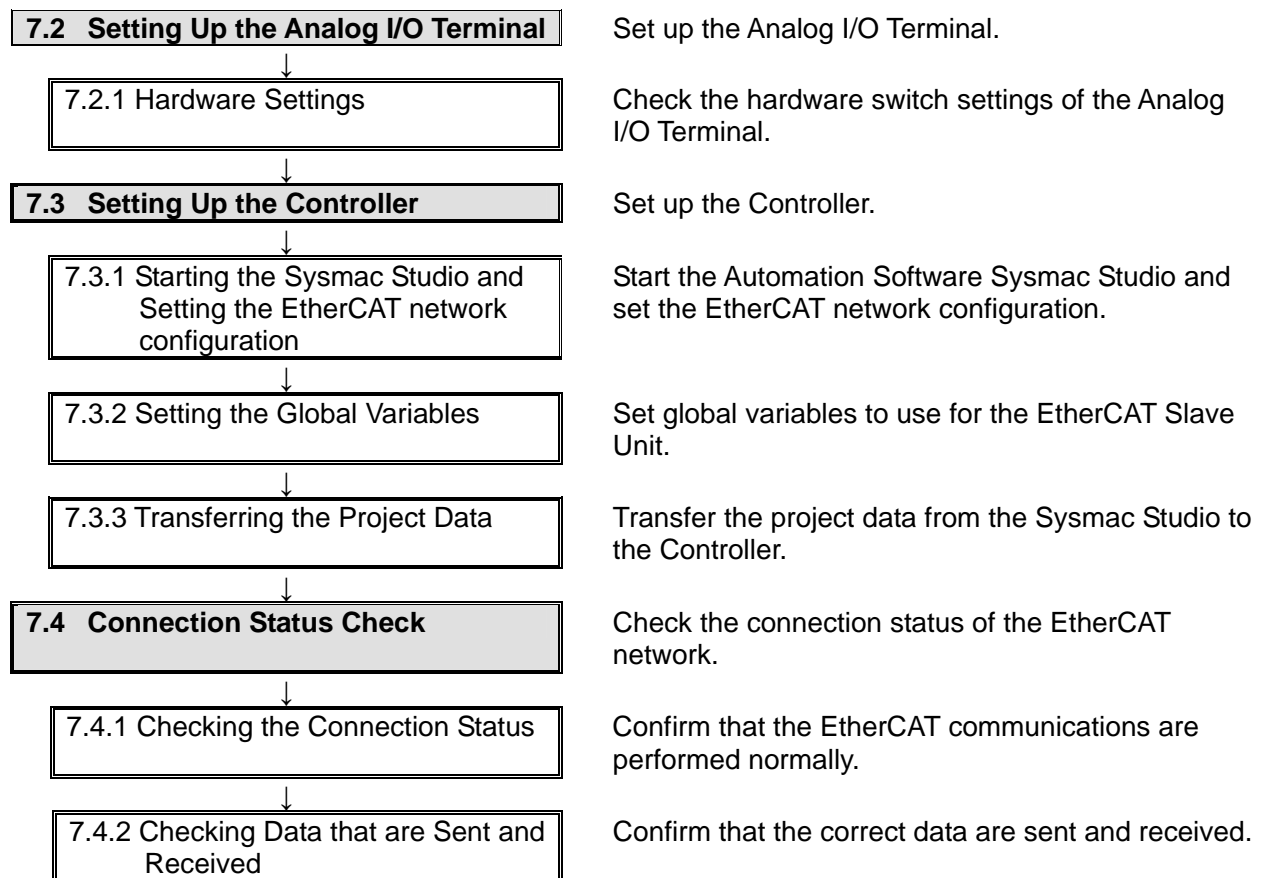

7.2. Setting Up the Analog I/O Terminal

Set up the Analog I/O Terminal.

7.2.1. Hardware Setting

Check the hardware switch settings of the Analog I/O Terminal.




Precautions for Correct Use

Make sure that the power supply is OFF when you perform the settings.

- 1 Confirm that the power supply to the Analog I/O Terminal is OFF.

*If the power supply is turned ON, settings may not be applicable as described in the following procedure.

- 2 Refer to the right figure and check the hardware switches.

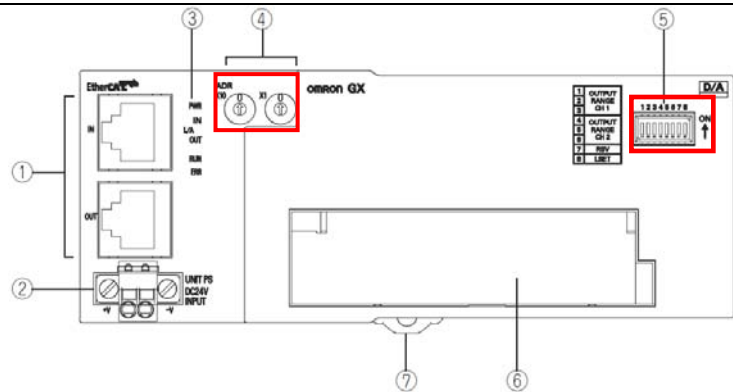


No.	Name
(1)	Communications connectors
(2)	Unit power supply connector
(3)	Status indicators
(4)	Node Address setting Switches
(5)	Output range setting Switches


- 3 Set the node address switches as follows.

x10: 0, x1: 1

*Set the node address to "01".

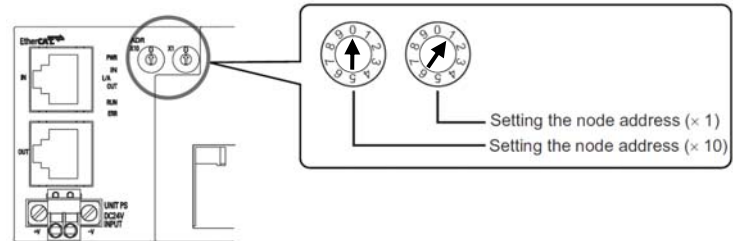

- 4 Turn OFF pins 1 to 7 of the output range setting switch (set them to bottom side), and turn ON pin 8 (set it to top side).

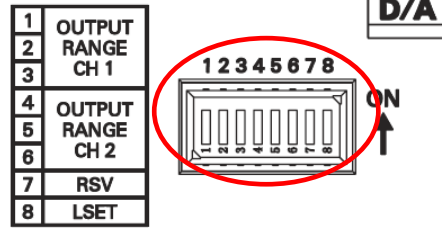

Pin No.	Setting	Specification
1		
2	Setting of output CH1 range	Set by combination of DIP switches (see the next table)
3		
4		
5	Setting of output CH2 range	
6		
7	Always OFF	Make sure to keep it OFF. The operation cannot be guaranteed when it is set to ON.
8	Output range setting method	OFF: Setting by SDO communications ON: Setting by these switches (Pin1 to Pin6)


- Setting of output CH1 range (Pin1 to Pin3)

Output range	Pin1	Pin2	Pin3
0 to 5 V	OFF	OFF	OFF
1 to 5 V	ON	OFF	OFF
0 to 10 V	OFF	ON	OFF
-10 to +10 V	ON	ON	OFF
4 to 20 mA	OFF	OFF	ON

- Setting of output CH2 range (Pin4 to Pin6)

Output range	Pin4	Pin5	Pin6
0 to 5 V	OFF	OFF	OFF
1 to 5 V	ON	OFF	OFF
0 to 10 V	OFF	ON	OFF
-10 to +10 V	ON	ON	OFF
4 to 20 mA	OFF	OFF	ON

- 5 Connect the Ethernet cable to communication connector CN1 and turn ON the power supply.

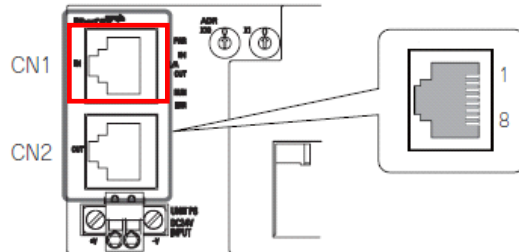
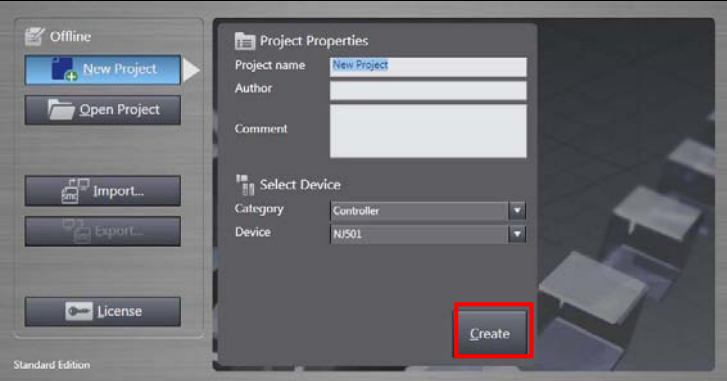
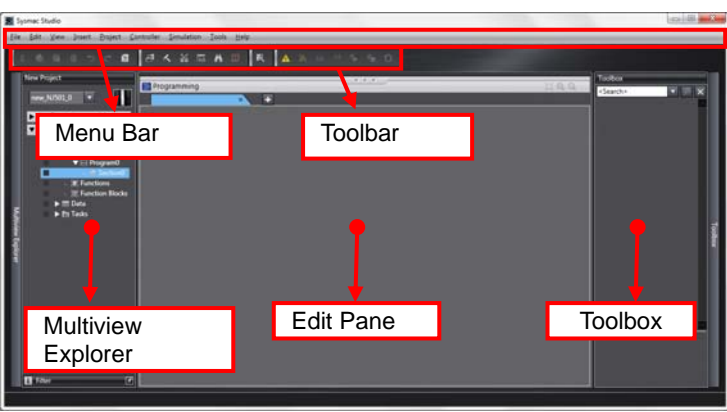
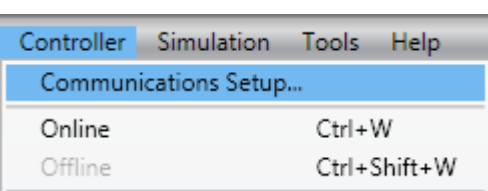





7.3. Setting Up the Controller

Set up the Controller.

7.3.1. Starting the Sysmac Studio and Setting the EtherCAT Network Configuration

Start the Automation Software Sysmac Studio and set the EtherCAT network configuration. Install the software and USB driver beforehand.


1	<p>Start the Sysmac Studio. Click the New Project Button.</p>	
2	<p>The Project Properties Dialog Box is displayed. Click the Create Button.</p> <p>*In this document, New Project is set as the project name.</p>	
3	<p>The New Project Pane is displayed. There are Menu Bar and Toolbar in the upper part of the pane. The left pane is called Multiview Explorer, the right pane is called Toolbox and the middle pane is called Edit Pane.</p>	
4	<p>Select Communications Setup from the Controller Menu.</p>	




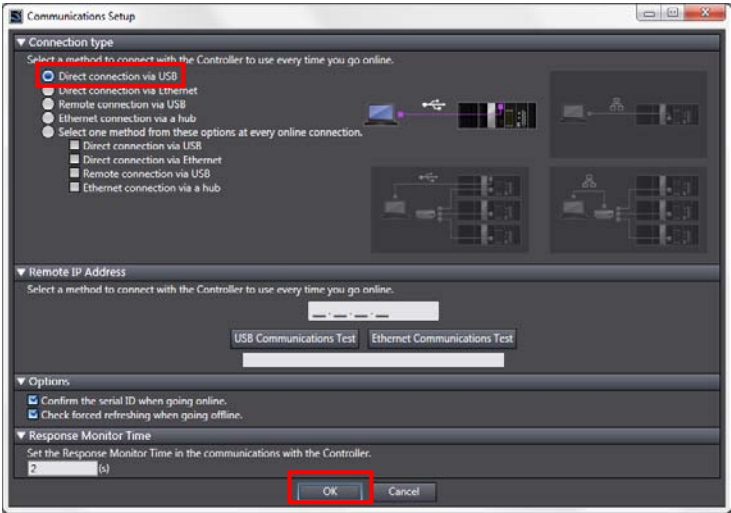
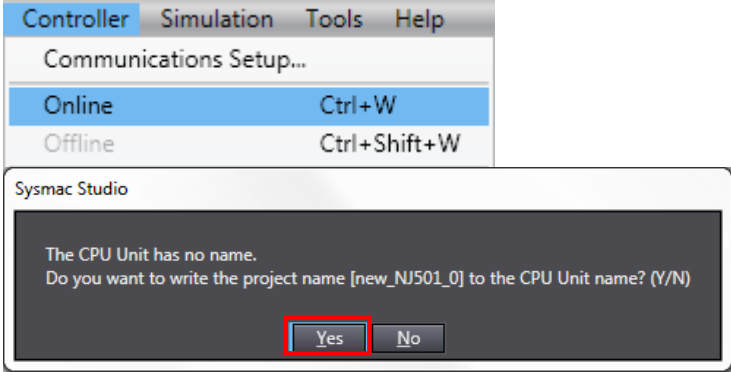

- 5 The Communications Setup Dialog Box is displayed. Select the *Direct connection via USB* Option in the Connection Type Field.
Click the **OK** Button.
- 
- 6 Select **Online** from the Controller Menu.
A confirmation dialog is displayed. Click the **Yes** Button.
*A displayed dialog depends on the status of the Controller used. Select the **Yes** Button or other button to proceed with the processing.
- 
- 7 When an online connection is established, a yellow bar is displayed on the top of the Edit Pane.
- 



Additional Information


For details on the online connections to a Controller, refer to *Section 5 Going Online with a Controller* in the *Sysmac Studio Version 1.0 Operation Manual (Cat. No. W504)*.

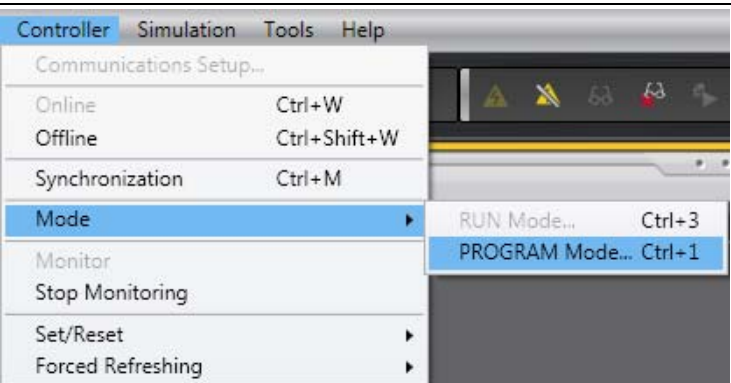- 8 Select **Mode - PROGRAM Mode** from the Controller Menu.
- 

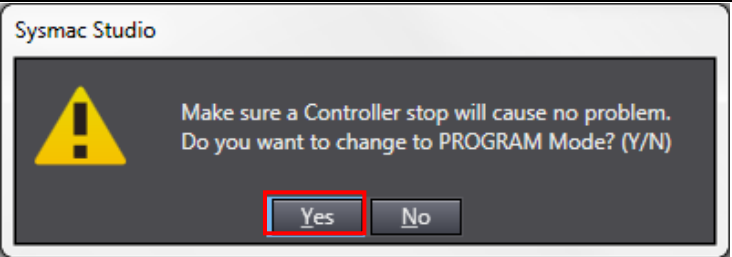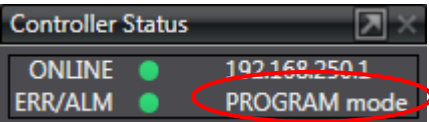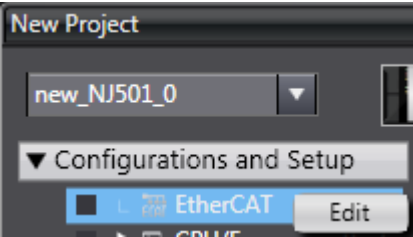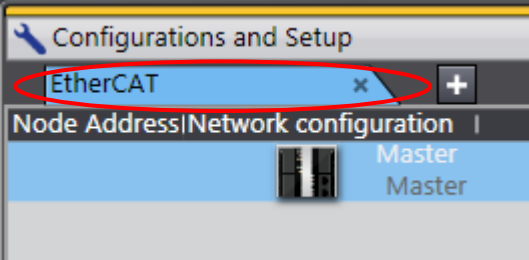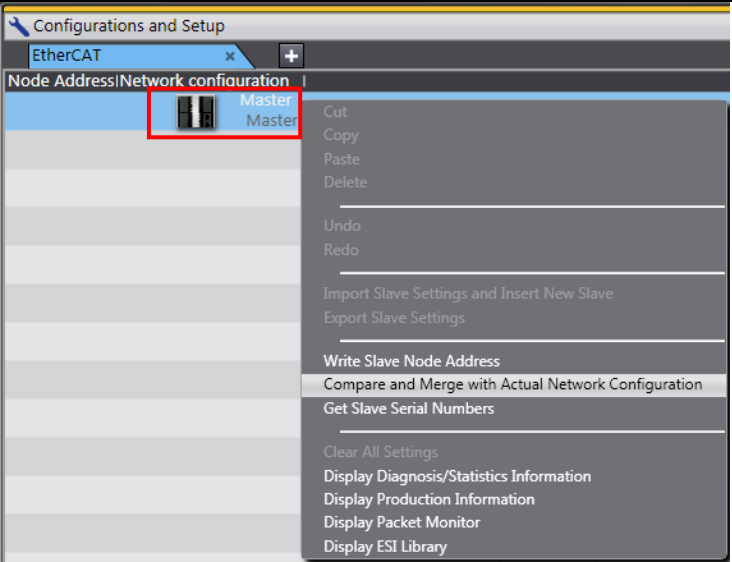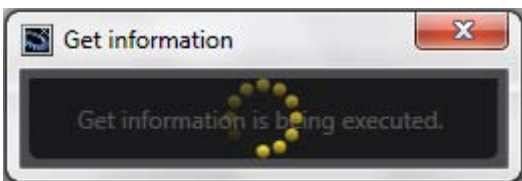
<p>9</p>	<p>A confirmation dialog is displayed. Click the Yes Button.</p> <p>Confirm that the controller status on the Toolbox is changed to the PROGRAM mode.</p>	 
<p>10</p>	<p>Double-click EtherCAT under Configurations and Setup in the Multiview Explorer. Or, right-click EtherCAT under Configurations and Setup and select Edit.</p>	
<p>11</p>	<p>The EtherCAT Tab Page is displayed in the Edit Pane.</p>	
<p>12</p>	<p>Right-click the Master Icon and select Compare and Merge with Actual Network Configuration.</p> <p>A screen is displayed stating "Get information is being executed".</p>	 

13 The Compare and Merge with Actual Network Configuration Pane is displayed. Node address 1 and GX-DA0271 Rev.1.1 are added to the actual network configuration of the comparison result.


Click the **Apply actual network configuration** Button.

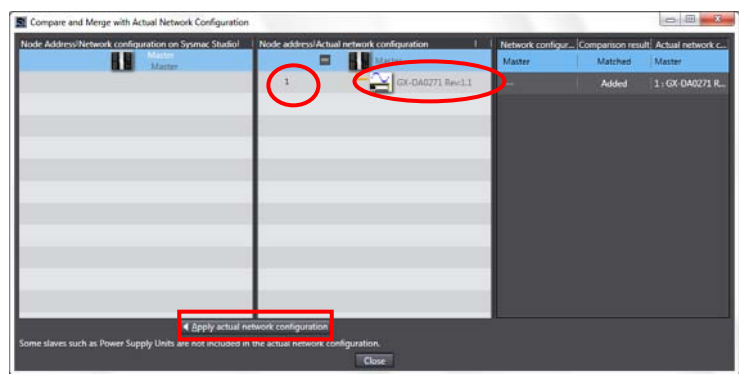


14 A confirmation dialog box is displayed. Click the **Apply** Button.

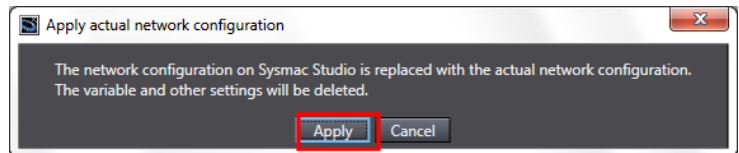

Confirm that node address 1 and E001 GX-DA0271 Rev.1.1 are added to the network configuration of the Sysmac Studio. Click the **Close** Button.



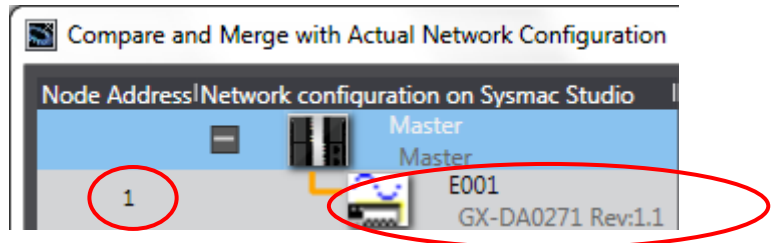


15 Node address 1 and E001 GX-DA0271 Rev:1.1 are added to the EtherCAT Tab Page in the Edit Pane.

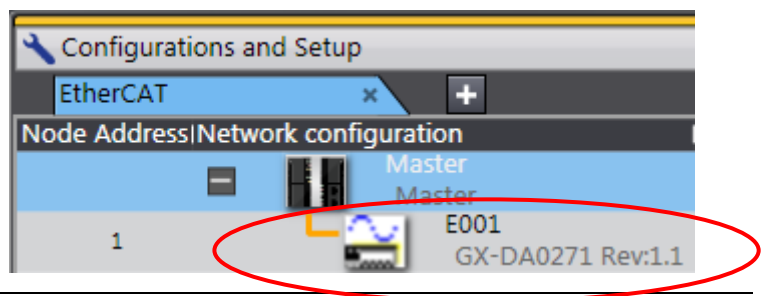


7.3.2. Setting Global Variables

Set global variables to use for the EtherCAT Slave Unit.
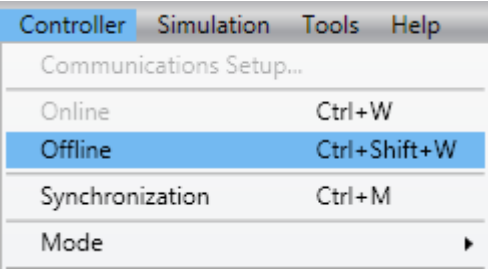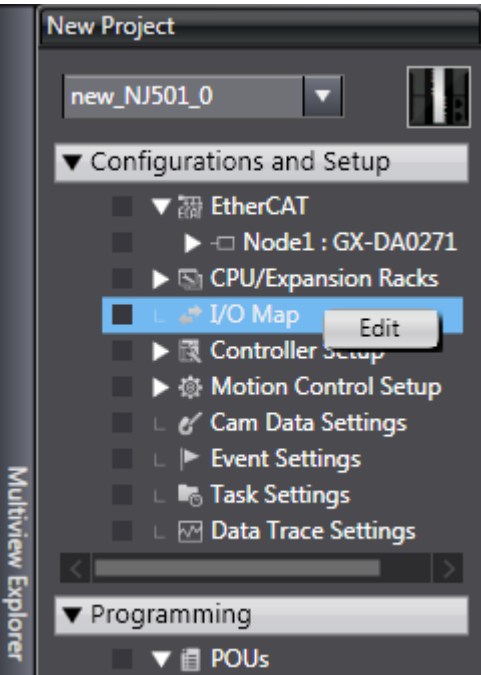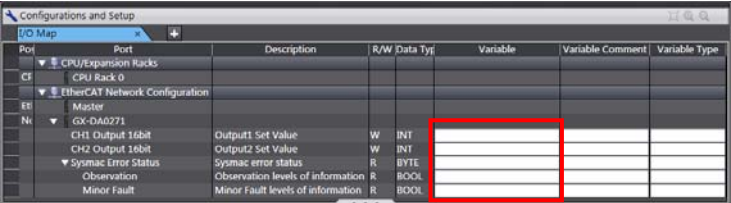
<p>1</p>	<p>Select Offline from the Controller Menu.</p>	 <p>The screenshot shows a menu with the following items: Controller (selected), Simulation, Tools, Help. Below this is a sub-menu titled 'Communications Setup...' with the following options: Online (Ctrl+W), Offline (Ctrl+Shift+W), Synchronization (Ctrl+M), and Mode (with a right-pointing arrow).</p>																																																																						
<p>2</p>	<p>Double-click I/O Map under Configurations and Setup on the Multiview Explorer, or right-click it and select Edit.</p>	 <p>The screenshot shows the 'Multiview Explorer' window. Under the 'Configurations and Setup' section, 'I/O Map' is selected and highlighted in blue. An 'Edit' button is visible next to it. Other items in the tree include EtherCAT, Node1 : GX-DA0271, CPU/Expansion Racks, Controller Setup, Motion Control Setup, Cam Data Settings, Event Settings, Task Settings, and Data Trace Settings.</p>																																																																						
<p>3</p>	<p>The I/O Map Tab Page is displayed on the Edit Pane.</p> <p>Click a column under Variable to enter a new variable.</p>	 <p>The screenshot shows a table titled 'I/O Map' with the following columns: Port, Description, R/W, Data Typ, Variable, Variable Comment, and Variable Type. The 'Variable' column is highlighted with a red box. The table contains several rows of data, including 'CH1 Output 16bit', 'CH2 Output 16bit', 'Sysmac Error Status', 'Observation', and 'Minor Fault'.</p> <table border="1"> <thead> <tr> <th>Port</th> <th>Description</th> <th>R/W</th> <th>Data Typ</th> <th>Variable</th> <th>Variable Comment</th> <th>Variable Type</th> </tr> </thead> <tbody> <tr> <td>CF</td> <td>CPU Rack 0</td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td>Et</td> <td>EtherCAT Network Configuration</td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td></td> <td>Master</td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td>Ni</td> <td>GX-DA0271</td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td></td> <td>CH1 Output 16bit</td> <td>W</td> <td>INT</td> <td></td> <td></td> <td></td> </tr> <tr> <td></td> <td>CH2 Output 16bit</td> <td>W</td> <td>INT</td> <td></td> <td></td> <td></td> </tr> <tr> <td></td> <td>Sysmac Error Status</td> <td>R</td> <td>BYTE</td> <td></td> <td></td> <td></td> </tr> <tr> <td></td> <td>Observation</td> <td>R</td> <td>BOOL</td> <td></td> <td></td> <td></td> </tr> <tr> <td></td> <td>Minor Fault</td> <td>R</td> <td>BOOL</td> <td></td> <td></td> <td></td> </tr> </tbody> </table>	Port	Description	R/W	Data Typ	Variable	Variable Comment	Variable Type	CF	CPU Rack 0						Et	EtherCAT Network Configuration							Master						Ni	GX-DA0271							CH1 Output 16bit	W	INT					CH2 Output 16bit	W	INT					Sysmac Error Status	R	BYTE					Observation	R	BOOL					Minor Fault	R	BOOL			
Port	Description	R/W	Data Typ	Variable	Variable Comment	Variable Type																																																																		
CF	CPU Rack 0																																																																							
Et	EtherCAT Network Configuration																																																																							
	Master																																																																							
Ni	GX-DA0271																																																																							
	CH1 Output 16bit	W	INT																																																																					
	CH2 Output 16bit	W	INT																																																																					
	Sysmac Error Status	R	BYTE																																																																					
	Observation	R	BOOL																																																																					
	Minor Fault	R	BOOL																																																																					

- 4 Right-click the row for Node1 and GX-DA0271. Then, select **Create Device Variable**.

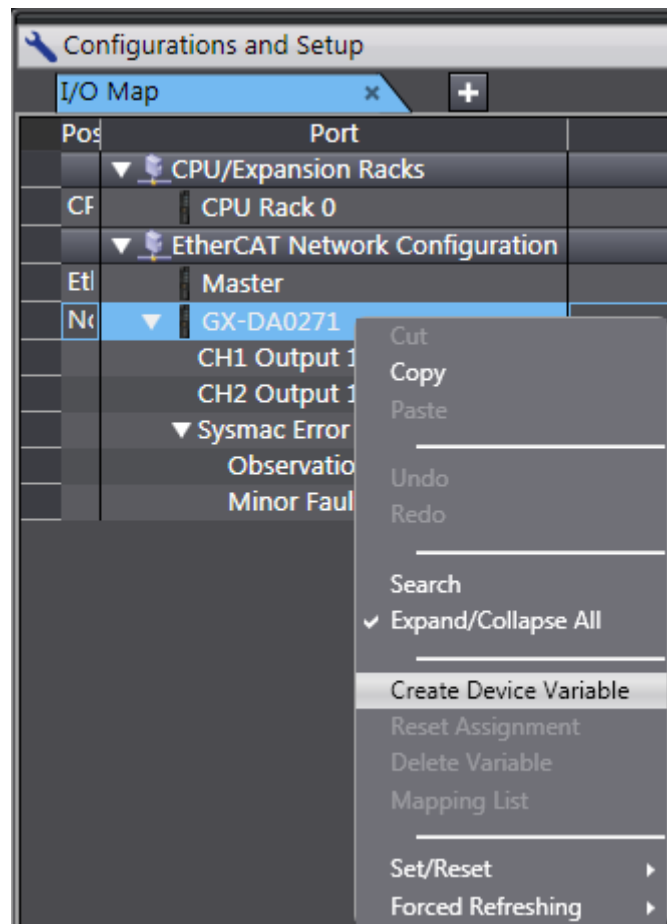

- 5 The Variable names and Variable Types are automatically set.

Port	Port	Description	R/W	Data Typ	Variable	Variable Comment	Variable Type
CF	CPU Rack 0						
Et	Master						
N1	GX-DA0271						
	CH1 Output 1	Output1 Set Value	W	INT	E001_CH1_Output_16bit		Global Variables
	CH2 Output 1	Output2 Set Value	W	INT	E002_CH2_Output_16bit		Global Variables
	Systemac Error Status	Systemac error status	R	BYT	E001_Systemac_Error_Status		Global Variables
	Observation	Observation levels of information	R	BOOK	E001_Observation		Global Variables
	Minor Fault	Minor Fault levels of information	R	BOOK	E001_Minor_Fault		Global Variables



Additional Information

The device variable names are created automatically from a combination of the device names and the I/O port names.

For slave units, the default device names start with an "E" followed by a sequential number starting from "001".



Additional Information

A device variable name is automatically created for each slave unit in the example above. A name can also be automatically created for each I/O port.

Also, you can set any device variables.

7.3.3. Transferring Project Data






Transfer the project data from the Sysmac Studio to the Controller.

⚠ WARNING

Always confirm safety at the destination node before you transfer a user program, configuration data, setup data, device variables, or values in memory used for CJ-series Units from the Sysmac Studio.

The devices or machines may perform unexpected operation regardless of the operating mode of the CPU Unit.

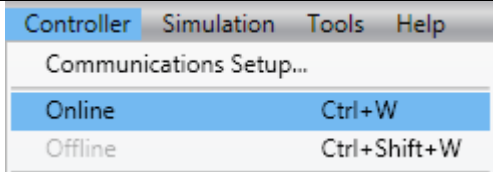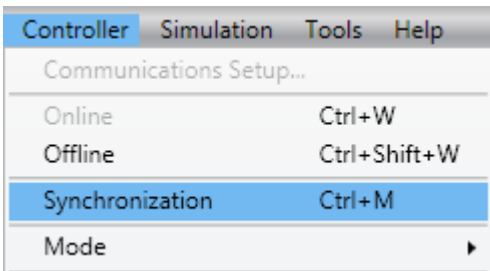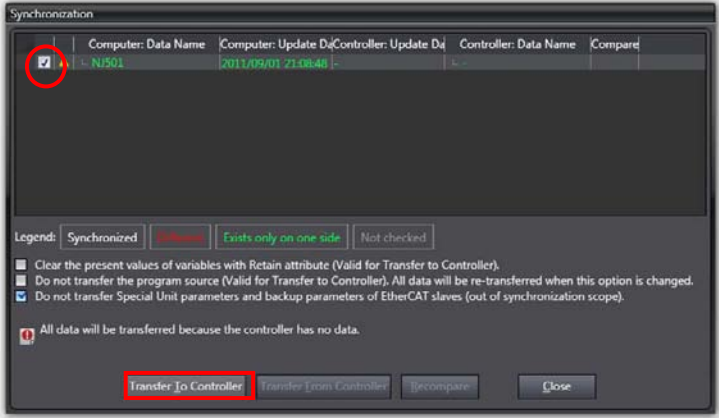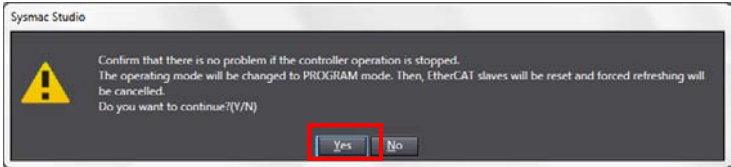

<p>1 Select Online from the Controller Menu.</p>	
<p>2 When an online connection is established, a yellow bar is displayed on the top of the Edit Pane.</p>	
<p>3 Select Synchronization from the Controller Menu.</p>	
<p>4 The Synchronization Dialog Box is displayed. Confirm that the data to transfer (NJ501 in the right figure) is selected. Then, click the Transfer to Controller Button.</p>	
<p>5 A confirmation dialog is displayed. Click the Yes Button.</p>	




A screen stating "Synchronizing" is displayed.



- 6 Confirm that the synchronized data is displayed with the color specified by "Synchronized", and that a message is displayed stating "The synchronization process successfully finished".

If there is no problem, click the **Close** Button.

*If the synchronization fails, check the wiring and repeat the procedure described in this section.

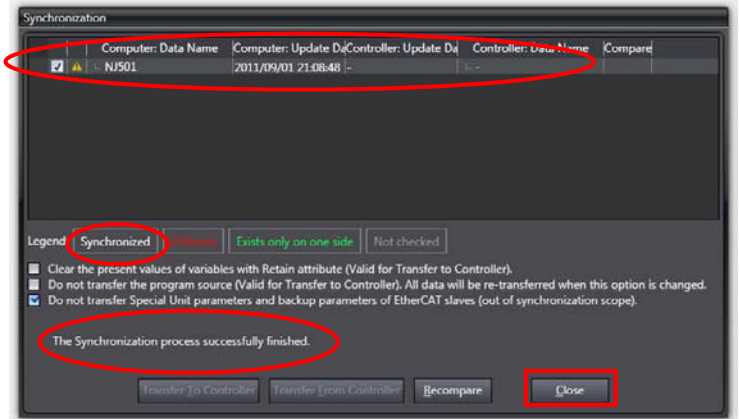


7.4. Connection Status Check

Check the connection status of the EtherCAT network.


7.4.1. Checking the Connection Status

Confirm that the EtherCAT communications are performed normally.


1 Select **Mode - RUN Mode** from the Controller Menu.

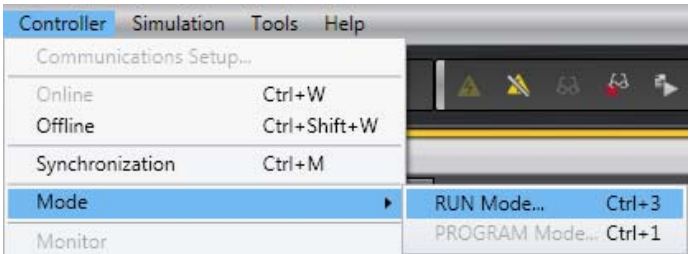


2 A confirmation dialog is displayed. Click the **OK** Button.

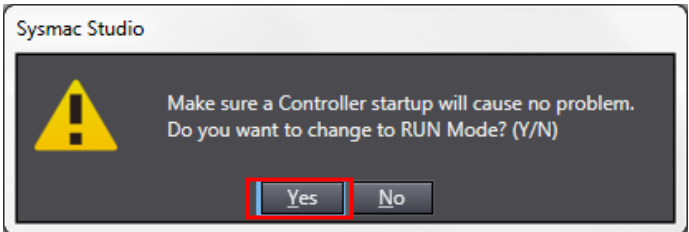

RUN mode is displayed on the Controller Status Pane.

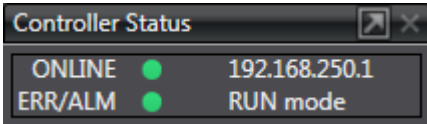

3 Check the LED indicators on the Controller to confirm if EtherCAT communication is normally performed.

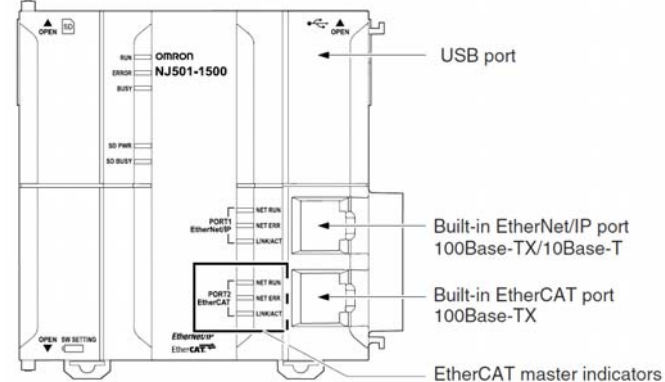

LED indicators in normal status

- [NET RUN]: Green ON
- [NET ERR]: OFF
- [LINK/ACT]: Flickering


Label	Name	Color	Status	Meaning
EtherCAT NET RUN	RUN	Green	Lit	EtherCAT communications are in progress. • I/O data is being input and output.
			Flashing	EtherCAT communications are established. Communications is in one of the following states. • Only message communications is functioning. • Only message communications and I/O data input operations are functioning.
			Not lit	EtherCAT communications are stopped. • Power is OFF or the Unit is being reset. • There is a MAC address error, communications controller error, or other error.
EtherCAT NET ERR	ERROR	Red	Lit	There is an unrecoverable error, such as a hardware error or an exception.
			Flashing	There is a recoverable error.
			Not lit	There is no error.
EtherCAT LINK/ACT	Link/Activity	Yellow	Lit	The link is established.
			Flashing	A link is established and data is being sent and received. The indicator flashes whenever data is sent or received.
			Not lit	The link is not established.

4 Check the LED indicators on the Analog I/O Terminal.

LED indicators in normal status

- [PWR]: Green ON
- [L/A IN]: Flickering
- [RUN]: Green ON
- [ERR]: OFF

The LED indicators flash at the same timing as those of the Controller.

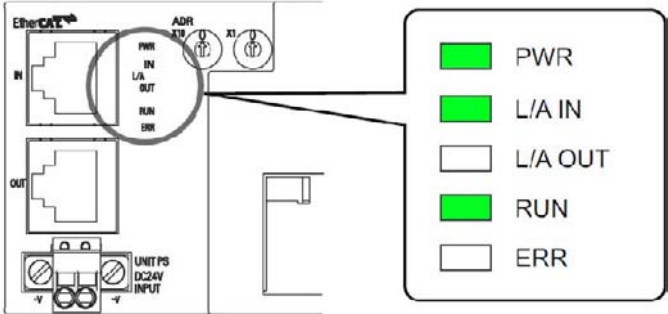

[PWR] indicator

Indicates the unit power supply state.

Color	State	Contents
Green	OFF	Unit power OFF state
	ON	The unit power (24 VDC) is supplied to the Slave Unit.

[L/A IN] indicator

Indicates the communication state (input side).

Color	State	Contents
Green	OFF	Link not established in physical layer
	Flickering	In operation after establishing link
	ON	Link established in physical layer

[RUN] indicator

It indicates the operation state.

Color	State	Contents
Green	OFF	Init state
	Blinking	Pre-Operational state
	Single flash	Safe-Operational state
	ON	Operational state

For details on each state, refer to "5-3 Communications State Transitions" in page 5 - 4.

[ERR] indicator

It indicates the information of an error.

Color	State	Contents
Red	OFF	No error
	Blinking	Communications setting error
	Single flash	Synchronization error or communications data error
	Double flash	Application WDT timeout
	Flickering	Boot error
	ON	PDI WDT timeout

7.4.2. Checking Data That Are Sent and Received

Confirm that the correct data are sent and received.


⚠ Caution

Sufficiently confirm safety before you change the values of variables on a Watch Tab Page when the Sysmac Studio is online with the CPU Unit. Incorrect operation may cause the devices that are connected to Output Units to operate regardless of the operating mode of the Controller.




- | 1 | Select Watch Tab Page from the View Menu. | <table border="1"> <thead> <tr> <th>View</th> <th>Insert</th> <th>Project</th> <th>Controller</th> <th>Simulatio</th> </tr> </thead> <tbody> <tr> <td>Output Tab Page</td> <td></td> <td></td> <td></td> <td>Alt+3</td> </tr> <tr style="background-color: #e1ecf4;"> <td>Watch Tab Page</td> <td></td> <td></td> <td></td> <td>Alt+4</td> </tr> <tr> <td>Cross Reference Tab Page</td> <td></td> <td></td> <td></td> <td>Alt+5</td> </tr> <tr> <td>Build Tab Page</td> <td></td> <td></td> <td></td> <td>Alt+6</td> </tr> </tbody> </table> | View | Insert | Project | Controller | Simulatio | Output Tab Page | | | | Alt+3 | Watch Tab Page | | | | Alt+4 | Cross Reference Tab Page | | | | Alt+5 | Build Tab Page | | | | Alt+6 |
|--------------------------|--|--|------------|--------------|---------|------------|------------|-----------------|--|--|--|-------|-----------------|--|--|--|-------|--------------------------|--|--|--|-------|----------------|--|--|--|-------|
| View | Insert | Project | Controller | Simulatio | | | | | | | | | | | | | | | | | | | | | | | |
| Output Tab Page | | | | Alt+3 | | | | | | | | | | | | | | | | | | | | | | | |
| Watch Tab Page | | | | Alt+4 | | | | | | | | | | | | | | | | | | | | | | | |
| Cross Reference Tab Page | | | | Alt+5 | | | | | | | | | | | | | | | | | | | | | | | |
| Build Tab Page | | | | Alt+6 | | | | | | | | | | | | | | | | | | | | | | | |
| 2 | The Watch Tab Page is displayed in the lower section of the Edit Pane. | <table border="1"> <thead> <tr> <th>Name</th> <th>Online value</th> <th>Modify</th> <th>Data type</th> <th>AT</th> </tr> </thead> <tbody> <tr> <td>Build Tab Page</td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td>Output Tab Page</td> <td></td> <td></td> <td></td> <td></td> </tr> <tr style="background-color: #e1ecf4;"> <td>Watch Tab Page</td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table> | Name | Online value | Modify | Data type | AT | Build Tab Page | | | | | Output Tab Page | | | | | Watch Tab Page | | | | | | | | | |
| Name | Online value | Modify | Data type | AT | | | | | | | | | | | | | | | | | | | | | | | |
| Build Tab Page | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Output Tab Page | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| Watch Tab Page | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| 3 | Click the cell that states Input Name at the bottom of the Watch Tab Page. | <table border="1"> <thead> <tr> <th>Name</th> <th>Online value</th> <th>Modify</th> <th>Data type</th> </tr> </thead> <tbody> <tr style="background-color: #e1ecf4;"> <td>Input Name</td> <td></td> <td></td> <td></td> </tr> </tbody> </table> | Name | Online value | Modify | Data type | Input Name | | | | | | | | | | | | | | | | | | | | |
| Name | Online value | Modify | Data type | | | | | | | | | | | | | | | | | | | | | | | | |
| Input Name | | | | | | | | | | | | | | | | | | | | | | | | | | | |

4 Now, characters can be entered. Enter the device variable name. Here, enter *E001_CH1_Output_16bit* of CH1 analog output. Type the first character E. A list of device variables starting with E is displayed. Scroll the list and select *E001_CH1_Output_16bit*. Double-click *E001_CH1_Output_16bit*. *E001_CH1_Output_16bit* is entered in the Name Column.

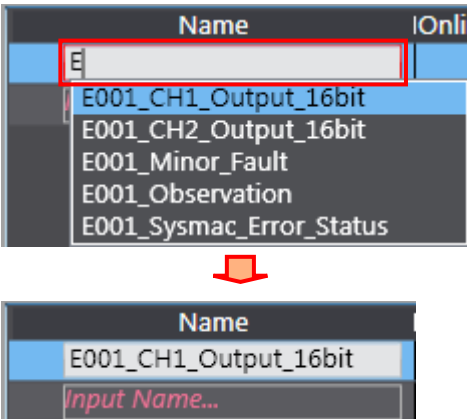


5 Enter the set value in the Modify Column. Here, enter "4000". (Half of resolution 1/8000)

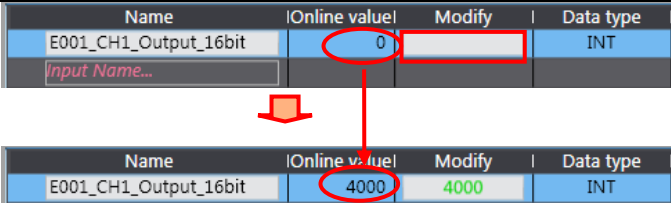

Confirm that the online value is changed to 4000.

6 Use a digital multimeter to confirm that the CH1 voltage output value is near 2.5 V.

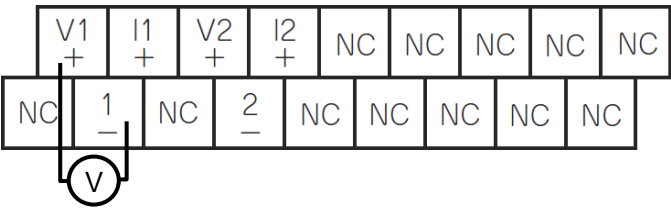


8. Initialization Method

This document explains the setting procedure from the factory default setting.

If the device settings have been changed from the factory default setting, some settings may not be applicable as described in this procedure.

8.1. Controller

To initialize the settings of the Controller, select **Clear All Memory** from the Controller Menu of the Sysmac Studio.

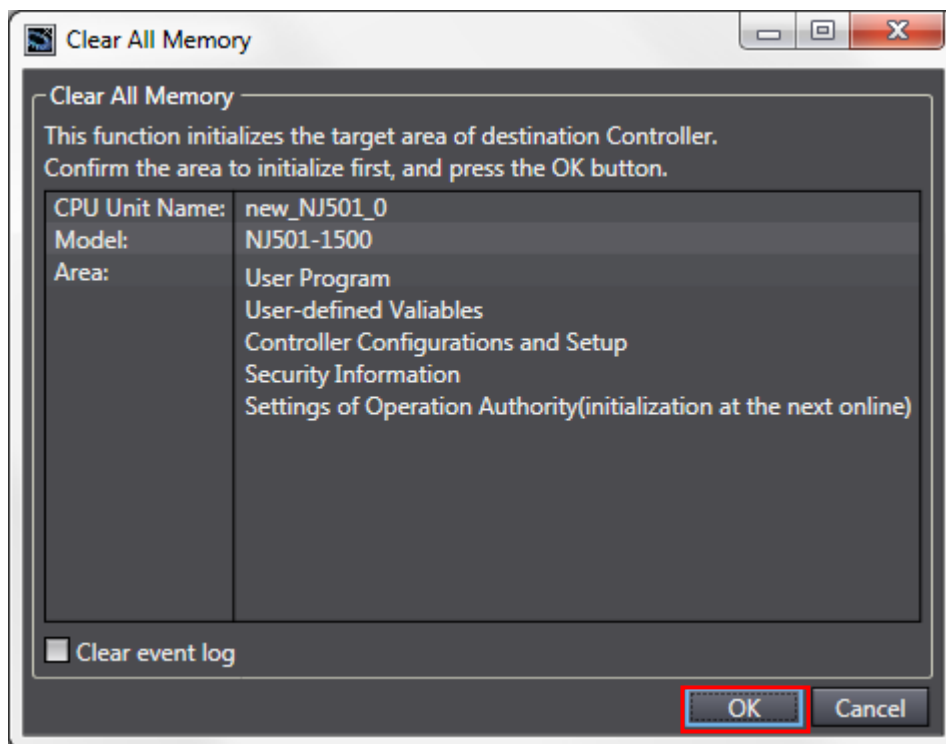

9. Revision History

Revision code	Date of revision	Revision reason and revision page
01	Feb. 28, 2013	First edition

OMRON Corporation Industrial Automation Company

Tokyo, JAPAN

Contact: www.ia.omron.com

Regional Headquarters

OMRON EUROPE B.V.

Wegalaan 67-69-2132 JD Hoofddorp
The Netherlands

Tel: (31)2356-81-300/Fax: (31)2356-81-388

OMRON ELECTRONICS LLC

One Commerce Drive Schaumburg,
IL 60173-5302 U.S.A.

Tel: (1) 847-843-7900/Fax: (1) 847-843-7787

OMRON ASIA PACIFIC PTE. LTD.

No. 438A Alexandra Road # 05-05/08 (Lobby 2),
Alexandra Technopark,
Singapore 119967

Tel: (65) 6835-3011/Fax: (65) 6835-2711

OMRON (CHINA) CO., LTD.

Room 2211, Bank of China Tower,
200 Yin Cheng Zhong Road,
PuDong New Area, Shanghai, 200120, China

Tel: (86) 21-5037-2222/Fax: (86) 21-5037-2200

Authorized Distributor:

© OMRON Corporation 201H All Rights Reserved.
In the interest of product improvement,
specifications are subject to change without notice.

Cat. No. P518-E1-01

0911(-)