



Installation

Dimensions

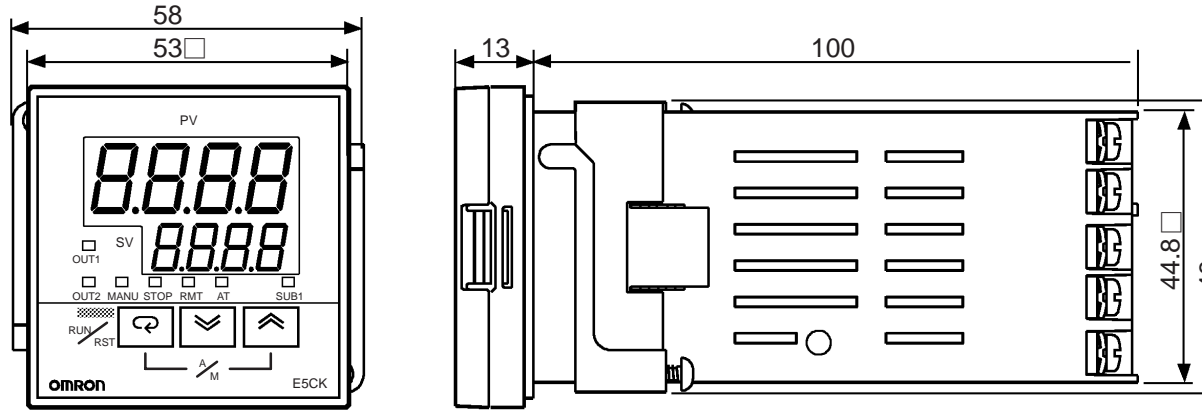


Panel cutout

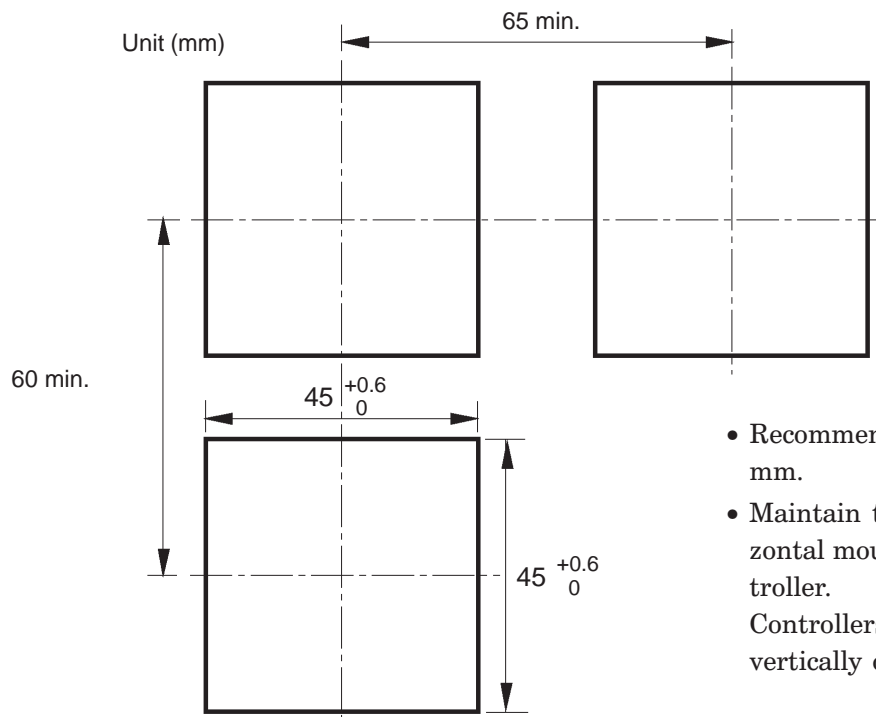

- Recommended panel thickness is 1 to 5 mm.
 - Maintain the specified vertical and horizontal mounting space between each controller.
- Controllers must not be closely mounted vertically or horizontally.

Mounting

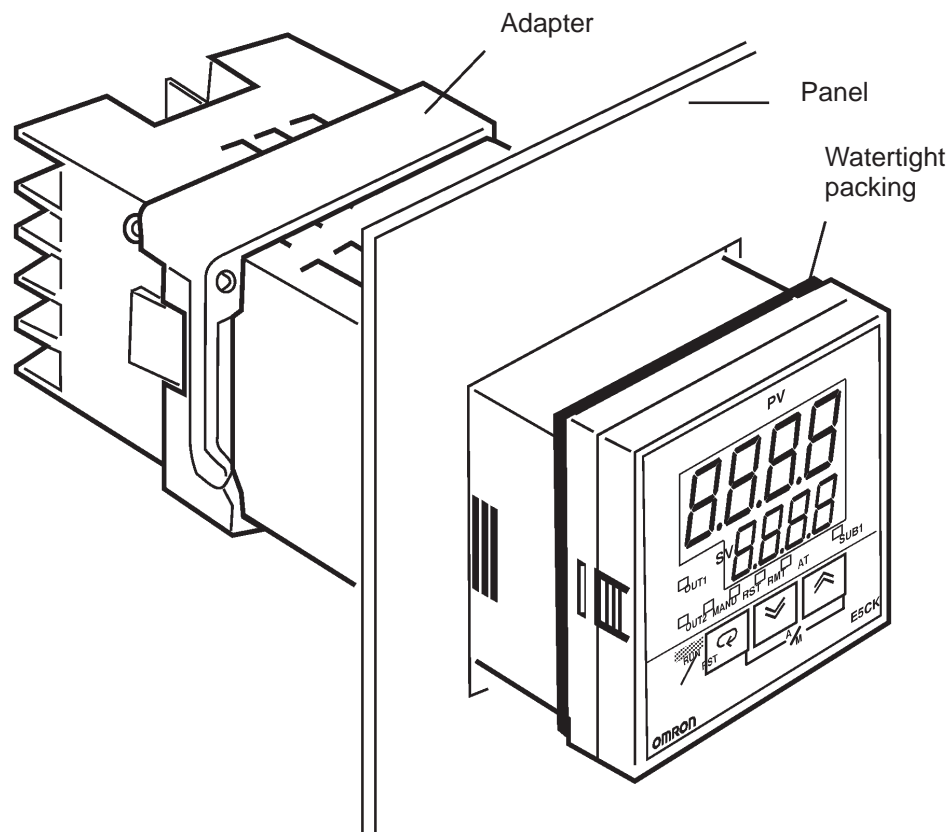

- (1) Insert the E5CK controller into the mounting hole in the panel at the position shown in the figure above.
- (2) Push the adapter along the controller body from the terminals up to the panel, and fasten temporarily.
- (3) Tighten the two fixing screws on the adapter. When tightening screws, tighten the two screws alternately keeping the torque to approximately 0.29 to 0.39 N·m, or 3 to 4 kgf·cm.



About the Terminal Cover

E5CK-AA1-500 controller is provided with a terminal cover (E53-COV07). Fasten the terminal cover as follows by using the snap pin.

