


## Appendix F

### Setting Examples

In the following example, with the K3NR, rotations (rpm) can be displayed using a rotary encoder that has 1,000 output pulses per revolution on condition that the prescaling bank is set to OFF, and the prescaling value is set to  $1/1,000 = 0.001 = 1 \times 10^{-3}$ .

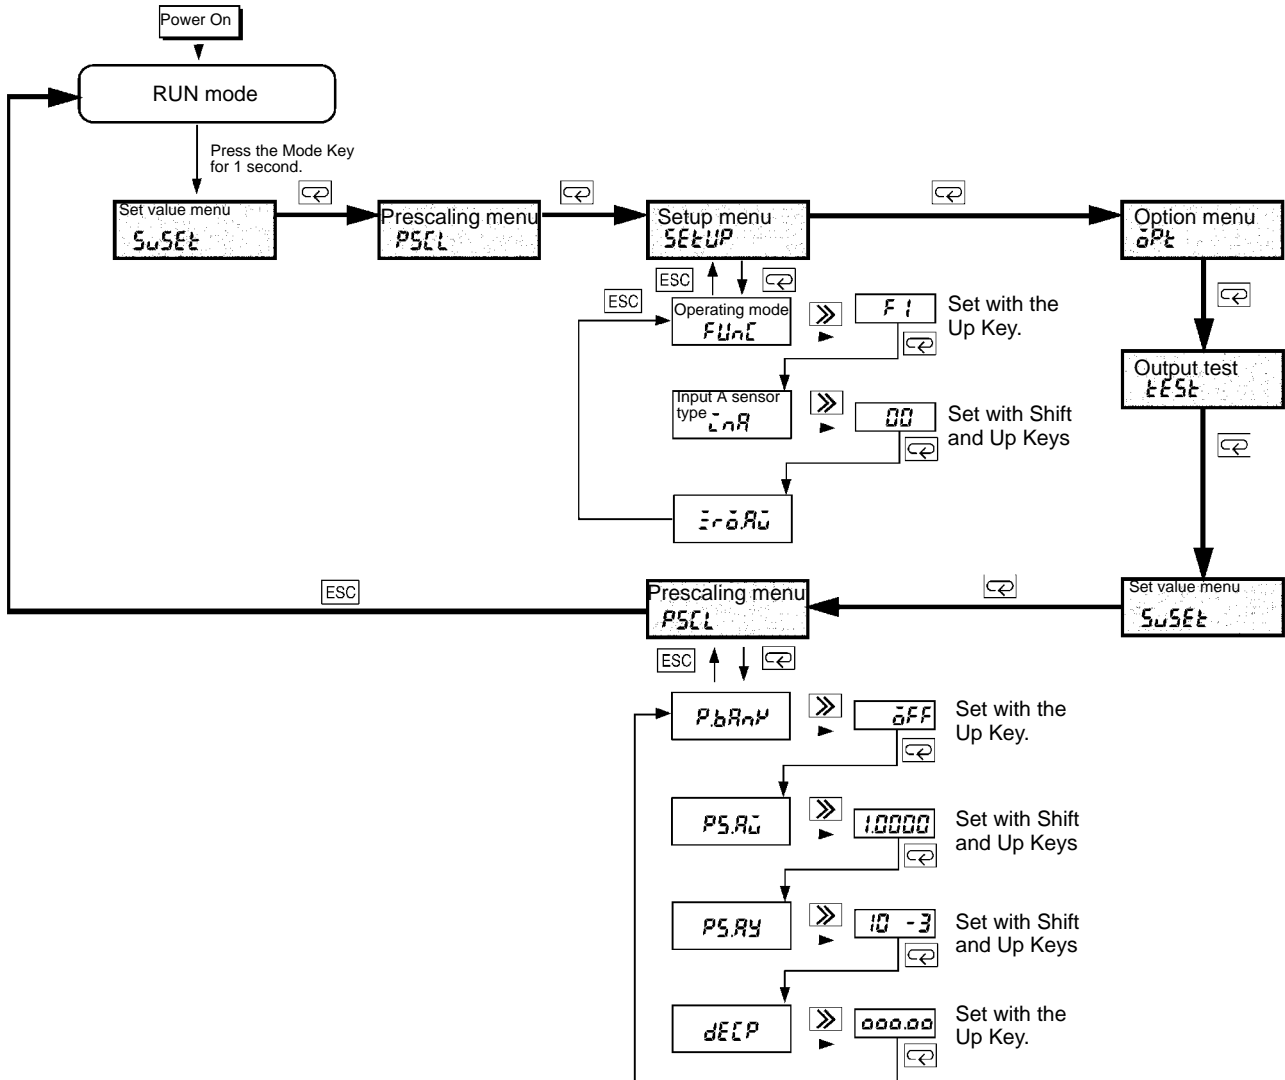

- Note**
1. If the operating mode setting is changed, all the other parameters are set to default values except those for the communications and settings in protect mode. Therefore, set the operating mode first.
  2. The displayed setting will be validated automatically if no change is made for five seconds and the next parameter will be displayed.