


Appendix E

Setting Examples

With the K3NV, the input of 0 to 20 mA can be converted and displayed within a range of 0 to 100.00 as shown below.

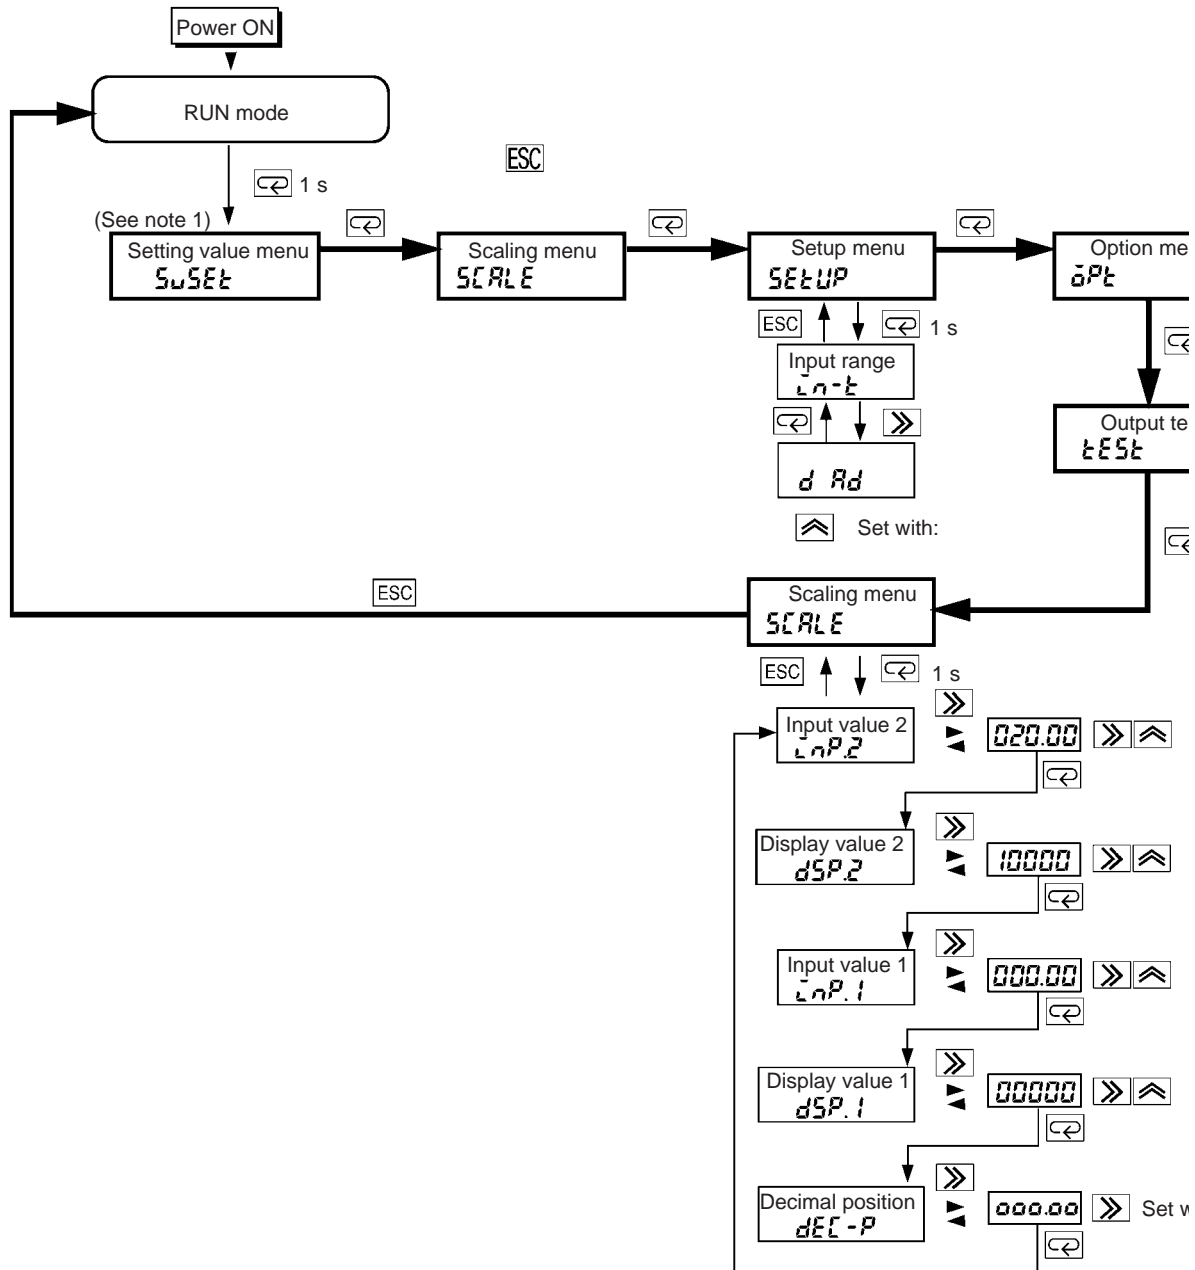

Note First set the input range because all the parameters are initialized when the input range settings are changed.

If no operation is executed for five seconds after changing the settings, the set values will be validated automatically and will be displayed.